


# CERTIFICATE

Certified Passive House Component

Component-ID 1327vs03 valid until 31st December 2021

Passive House Institute  
Dr. Wolfgang Feist  
64283 Darmstadt  
Germany

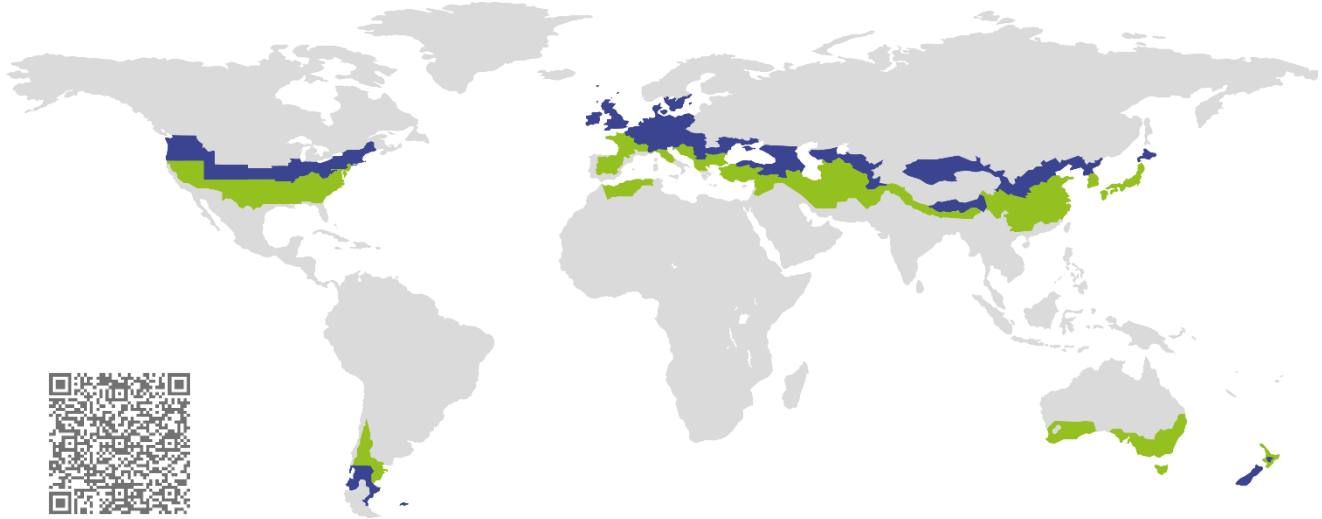

Category: **Air handling unit with heat recovery**  
Manufacturer: **Meltem Wärmerückgewinnung GmbH & Co. KG**  
**Germany**  
Product name: **M-WRG-II P without and with channel interface**  
Specification: Decentralised single room ventilation system  
Heat exchanger: Recuperative

**This certificate was awarded based on the product meeting the following main criteria**

Heat recovery rate  $\eta_{HR} \geq 75 \%$   
Specific electric power  $P_{el,spec} \leq 0.45 \text{ Wh/m}^3$   
Leakage  $< 3 \%$  <sup>1)</sup>  
Comfort Supply air temperature  $\geq 16.5 \text{ }^\circ\text{C}$   
at outdoor air temperature of  $-10 \text{ }^\circ\text{C}$

Airflow range
10 - 51 m <sup>3</sup> /h <sup>1)</sup> (continuous operation)
10 - 77 m <sup>3</sup> /h <sup>1)</sup> (on-demand operation for elimination of increased loads)
Heat recovery rate
$\eta_{HR} = 82 \%$ <sup>1)</sup>
Specific electric power
$P_{el,spec} = 0.35 \text{ Wh/m}^3$ <sup>1)</sup>

<sup>1)</sup> The values apply to the wall-integrated installation variant U<sup>2</sup> with a connected duct (supply air or extract air). Values for other installation variants are shown in the appendix to the certificate.



### Passive House comfort criterion

A minimum supply air temperature of 16.5 °C is maintained at an outdoor air temperature of -10 °C. Please note that the unit switches to disbalanced operation at a low outdoor temperatures.

### Efficiency criterion (heat recovery rate)

The effective heat recovery rate is measured at a test facility using balanced mass flows of the outdoor and exhaust air. The boundary conditions for the measurement are documented in the testing procedure.

$$\eta_{HR} = \frac{(\theta_{ETA} - \theta_{EHA}) + \frac{P_{el}}{\dot{m} \cdot c_p}}{(\theta_{ETA} - \theta_{ODA})}$$

With

- $\eta_{HR}$  Heat recovery rate in %
- $\theta_{ETA}$  Extract air temperature in °C
- $\theta_{EHA}$  Exhaust air temperature in °C
- $\theta_{ODA}$  Outdoor air temperature in °C
- $P_{el}$  Electric power in W
- $\dot{m}$  Mass flow in kg/h
- $c_p$  Specific heat capacity in Wh/(kg.K)

There are various installation variants for the device under investigation. The following values were obtained for the respective installation variant:

Installation variant	Airflow range continuous operation	Heat recovery rate	Airflow range on-demand operation	Heat recovery rate
	[m³/h]	[%]	[m³/h]	[%]
Externally mounted / AP	10 - 30	84	10 - 53	83
Partially integrated / UP	10 - 32	84	10 - 57	83
Partially integrated with channel interface	10 - 33	84	10 - 59	83
Fully integrated U² with channel interface	10 - 51	83	10 - 77	82

## Efficiency criterion (electric power)

The ventilation unit is offered in various versions. The following electrical power consumption was determined depending on the connection variant:

Connection variant	Elektrische Leistungsaufnahme [Wh/m <sup>3</sup> ]
Free blowing	0.31
Connection supply air (dP 50 Pa) / extract free blowing or Supply free blowing / connection extract air (dP 50 Pa)	0.35
Connection of supply and extract air duct (each dP 50 Pa)	0.40

## Efficiency ratio

The efficiency ratio provides information about the overall energy performance of the respective ventilation unit. It specifies the achieved reduction in ventilation heat losses by using a ventilation unit with heat recovery rather than without.

Efficiency ratio
$\epsilon_L = 0.60$

## Leakage

The leakage airflow must not exceed 3 % of the average airflow of the unit's operating range. The test to determine the leakages was carried out in accordance with the DIN 13141-8 standard.

Internal leakage	External leakage
0.27 %	2.19 %

## Settings and airflow balance

It must be possible to adjust the balance between the exhaust airflow rate and the outdoor airflow rate for all units.

- This unit is certified for airflow rates of 10 - 51 m<sup>3</sup>/h (continuous operation) resp. 10 - 77 m<sup>3</sup>/h (on-demand operation for elimination of increased loads).
- Balancing of the airflow rates of the unit is possible.
  - ✓ The airflow volumes can be held steady automatically (by constant airflow volume fans).
- The users should have at least following possibilities for adjustment:
  - ✓ Switching the system on and off
  - ✓ For the examined device 5 comfort levels can be selected by the user.
- The standby power consumption of this device makes 0.8 W. Hereby complies with the target value of 1 W.
- After a power failure, the device will automatically resume operation.

## Indoor air quality

This unit is equipped with following filter qualities by default:

Outdoor air filter	Extract air filter
ISO ePM1 60%	ISO Coarse 60%

On the outside air side, a fine filter of efficiency ISO ePM1 50% (F7 according to En 779) or better is recommended. If not standard, a filter with recommended efficiency is offered as optional equipment or accessory by the manufacturer.

If the device is not operated during the summer, the filter should be replaced before the next operation.

## Acoustical testing

The noise limits in living rooms of 25 dB(A) for continuous operation and 35 dB(A) for ventilation on demand are complied with within the listed airflow-ranges on page 2. Since it can be assumed that the unit will be installed in a living room, the sound pressure level in installation room should be restricted to 25 dB(A).

The following sound levels are achieved by the unit for the various installation variants as a function of the airflow rate:

Luftvolumenstrom [m <sup>3</sup> /h]	10	20	30	40	50	60	70	80
AP Sound power level L <sub>w</sub> [dB(A)]	21.5	25.4	29.9	35.0	37.9	40.6	43.3	46.4
AP Sound pressure level at 10 m <sup>2</sup> of room absorption area (e.g. living room) L <sub>p</sub> [dB(A)]	17.5	21.4	25.9	31.0	33.9	36.6	39.3	42.4
UP Sound power level L <sub>w</sub> [dB(A)]	17.0	21.9	27.7	32.2	36.2	40.1	42.8	46.1
UP Sound pressure level at 10 m <sup>2</sup> of room absorption area (e.g. living room) L <sub>p</sub> [dB(A)]	13.0	17.9	23.7	28.2	32.2	36.1	38.8	42.1
UP with channel interface Sound pressure level L <sub>w</sub> [dB(A)]	16.6	20.8	26.5	32.6	35.3	39.3	42.0	45.4
UP with channel interface Sound pressure level at 10 m <sup>2</sup> of room absorption area (e.g. living rooms) L <sub>p</sub> [dB(A)]	12.6	16.8	22.5	28.6	31.3	35.3	38.0	41.4
U <sup>2</sup> with channel interface Sound power level L <sub>w</sub> [dB(A)]	12.4	16.5	19.7	24.9	28.4	32.6	36.5	40.0
U <sup>2</sup> with channel interface Sound pressure level at 10 m <sup>2</sup> of room absorption area (e.g. living room) L <sub>p</sub> [dB(A)]	8.4	12.5	15.7	20.9	24.4	28.6	32.5	36.0

## Frosts protection

Appropriate measures should be taken to prevent the heat exchanger and optional downstream hydraulic heater coil from getting damaged by frost during extreme winter temperatures ( $-15\text{ }^{\circ}\text{C}$ ). It must be ensured that the unit's ventilation performance is not affected during frost protection cycles (an outside air interruption circuit is out of the question in systems suitable for passive houses, because the heating loads occurring as a result of forced infiltration become unacceptably high).

- Frosts protection of the heat exchanger:
  - ✓ In order to prevent the heat exchanger from freezing up, the temperature is monitored continuously. If the exhaust air temperature falls below a value of  $-1.5\text{ }^{\circ}\text{C}$ , the supply air and/or extract air volume flow is gradually changed by the motor control system depending on the ventilation stage set, so that the proportion of the exhaust air is increased. This results in a temperature increase on the exhaust air side. Frost protection operation ends when the exhaust air temperature is permanently above  $5.5\text{ }^{\circ}\text{C}$  and both fans are operated balanced.
  - ✓ The outside temperature when the frost protection was activated was approx.  $-6.5\text{ }^{\circ}\text{C}$ .

## Peculiarity

The condensate produced in the heat exchanger at cold outside air temperatures is discharged via a condensate connection on the exhaust air pipe or on-site connection to the building.